



**SUBMITTAL DRAWING**  
**AMI - 55 CRD**  
**CEILING RADIATION DAMPERS (ROUND )**

**STANDARD CONSTRUCTION**

**FRAME**

22 ga. Rollformed galvanized steel

**BLADES**

22 ga. Galvanized steel

**FUSIBLE LINKS**

165 deg, Standard

**FINISH**

Mill

**MAXIMUM SIZE**

24" Diameter


**MINIMUM SIZE**

4" dia

**Note:**

1. Ceramic Insulation is not UL required on Dampers with areas less than 80 sq. in. and is optional. Dampers above 80 sq. in. will be provided with Blade Insulation.

U.L.Classified  
1 1/2 Hour Rating

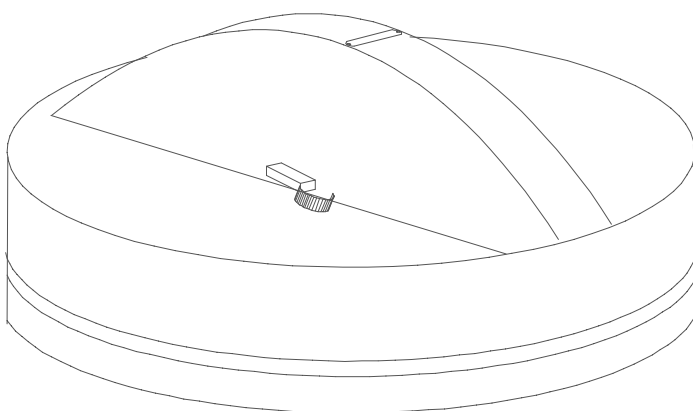

UNDERWRITERS LABORATORIES (UL555)  
CLASSIFIED FIRE DAMPERS  
FIRE RESISTANCE RATED 3 HOURS.  
FOR USE IN UL CLASSIFIED BUILDING  
MATERIALS RATED 4 HOURS OR LESS.

Project:  
Location:  
Architect  
Engineer:

Contractor:  
Address:  
P.O. Number:  
Date: